


REVISIONS	BY	DESCRIPTION	DATE	APPROVED
1	J	ADDED CAPACITOR C12	5-14/09	M.K. B/P

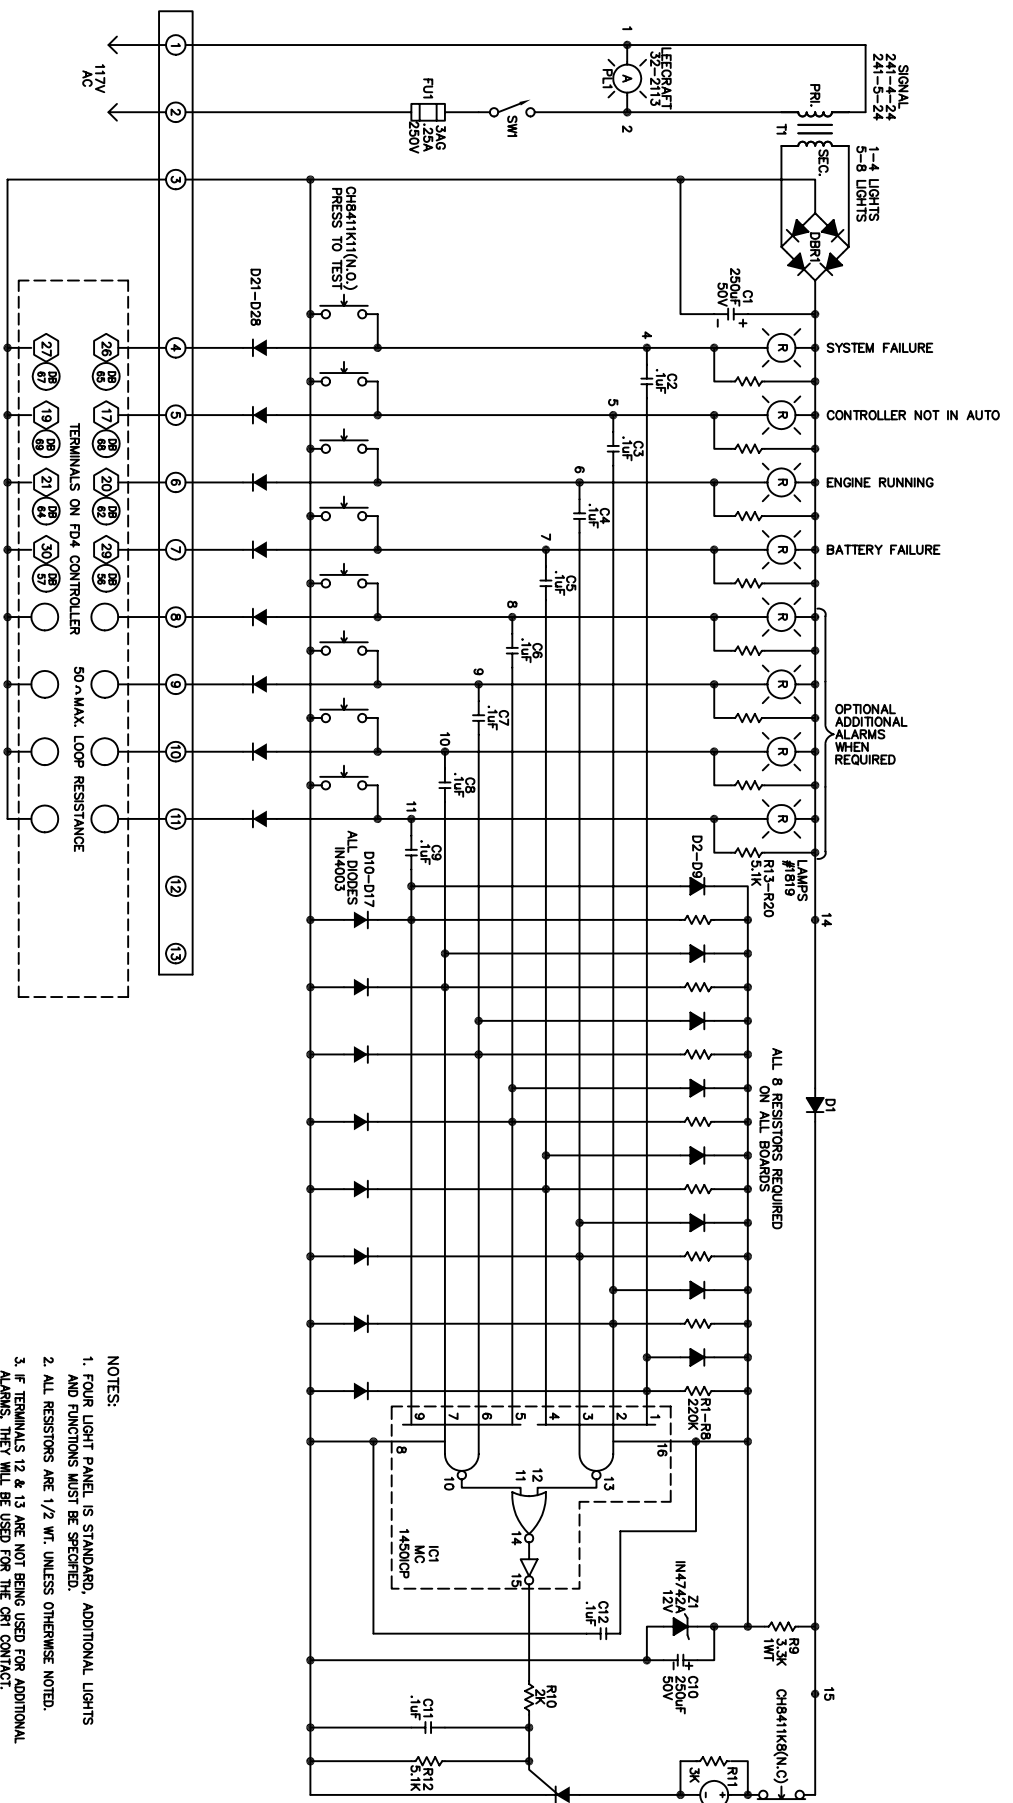

- NOTES:
1. FOUR LIGHT PANEL IS STANDARD. ADDITIONAL LIGHTS AND FUNCTIONS MUST BE SPECIFIED.
 2. ALL RESISTORS ARE 1/2 WT. UNLESS OTHERWISE NOTED.
 3. IF TERMINALS 12 & 13 ARE NOT BEING USED FOR ADDITIONAL ALARMS, THEY WILL BE USED FOR THE CRT CONTACT.
 4. * DENOTES OPTIONAL COMPONENTS.
 5. ○ DENOTES TERMINALS ON ANY METRON FD4 CONTROLLER
 6. ◊ DENOTES TERMINALS ON METRON FD2 CONTROLLER

SCHEMATIC MODEL 1802B, REMOTE ALARM PANEL CLOSE CIRCUIT TO ALARM		DRAWN J.L. 4-17-89		METRON, INC. DENVER, CO.	
		CHECK D.B. 4-19-89			
		APP'D D.B. 4-19-89			
		OPTIONAL CS30665J		SCALE N.T.S. SHEET 1 OF 1	