REVISIONS	SYM	DESCRIPTION	DATE	APPROVED
	S	ADDED CAPACITOR C12	5-14-09	M.K. BP

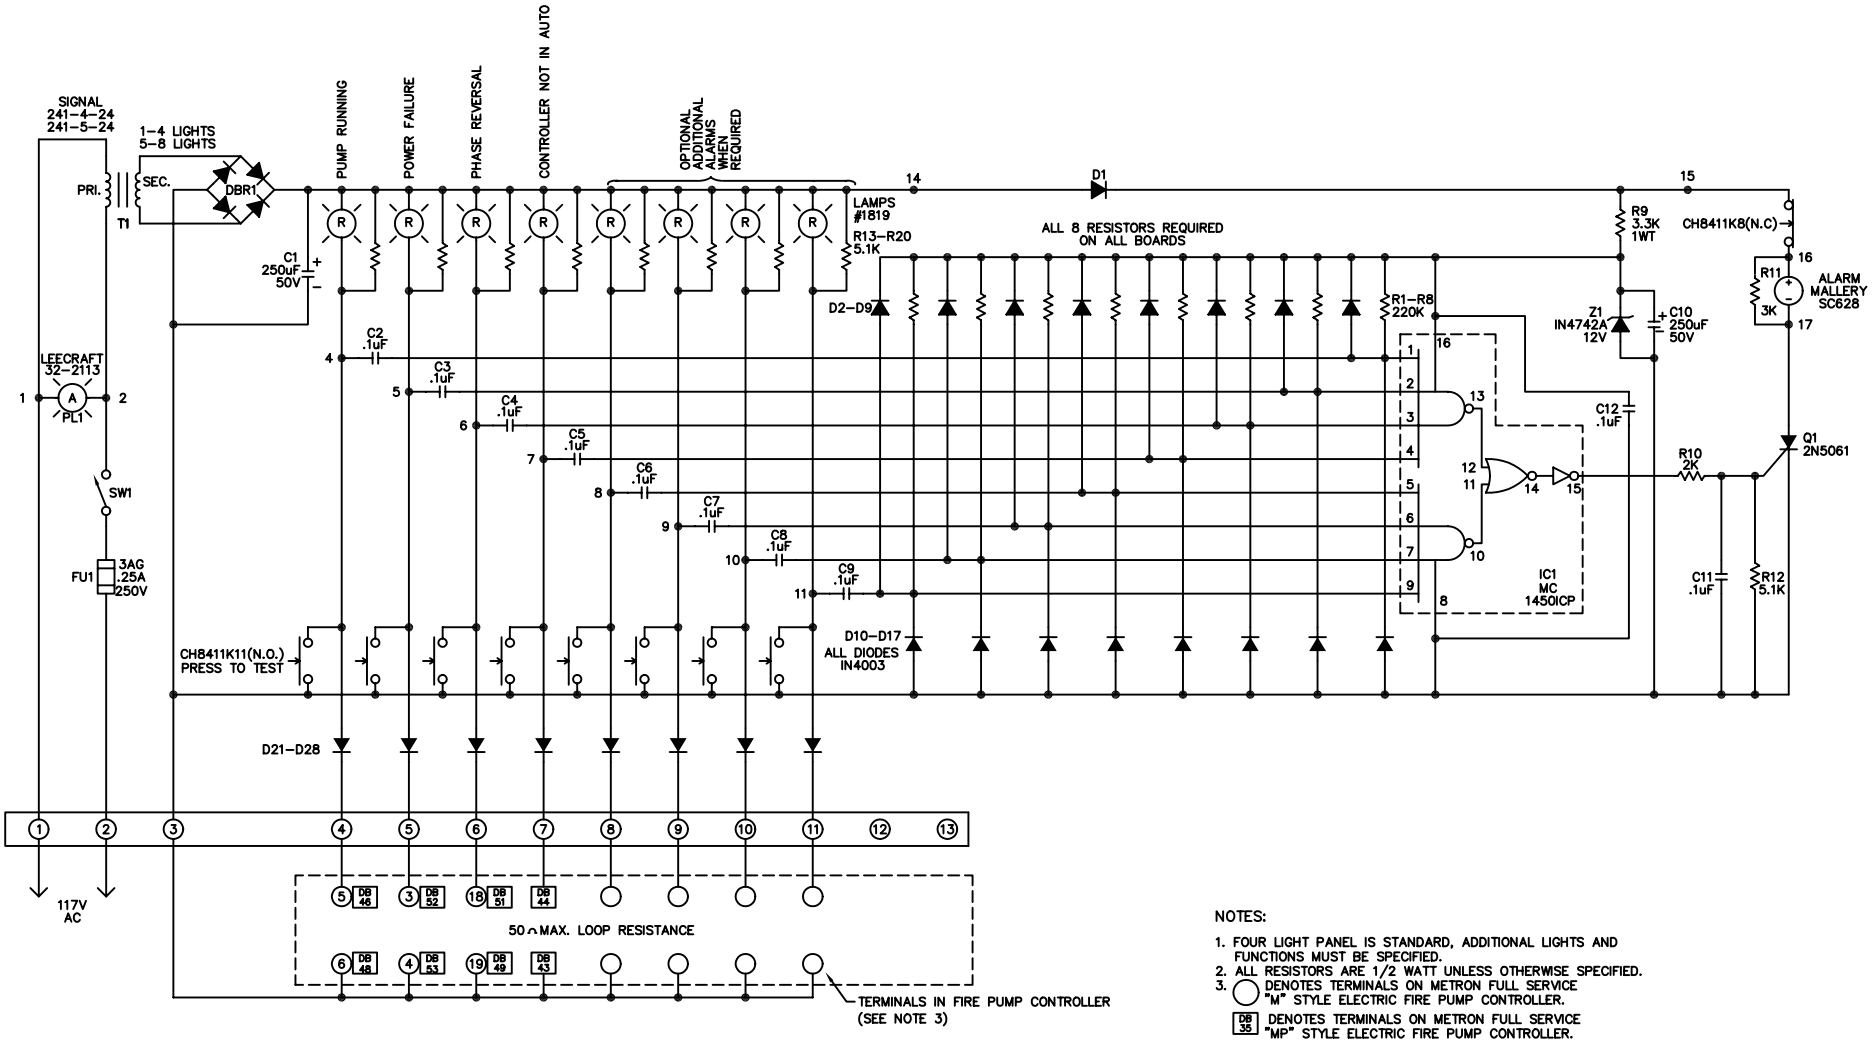

NOTES:

1. FOUR LIGHT PANEL IS STANDARD, ADDITIONAL LIGHTS AND FUNCTIONS MUST BE SPECIFIED.
2. ALL RESISTORS ARE 1/2 WATT UNLESS OTHERWISE SPECIFIED.
3. ○ DENOTES TERMINALS ON METRON FULL SERVICE "M" STYLE ELECTRIC FIRE PUMP CONTROLLER.
   [DB 35] DENOTES TERMINALS ON METRON FULL SERVICE "MP" STYLE ELECTRIC FIRE PUMP CONTROLLER.
4. IF TERMINALS 10 & 11 ARE NOT BEING USED FOR ADDITIONAL ALARMS, THEY WILL BE USED FOR THE CR1 CONTACT.
5. * DENOTES OPTIONAL COMPONENTS.

QTY	PART NO.	DESCRIPTION	MATERIAL	ITEM

LIST OF MATERIAL

NEXT ASSY	FINAL ASSY	NEXT ASSY	FINAL ASSY
APPLICATION		QTY REQD	

DRAWING CHECKED BY:
TOLERANCES ARE: X ± .030 XX ± .015 XXX ± .005 ANGLES ± 0.5°
REMOVE BURRS & SHARP CORNERS

DRAWN	J.I.	4-17-89
CHECK	BP	4-19-89
APPD	BP	4-19-89

METRON, INC.
DENVER, CO.

SCHEMATIC
MODEL 1701C, REMOTE ALARM PANEL
CLOSE CIRCUIT TO ALARM

OPTIONS:
CS30674S

SCALE N.T.S. SHEET 1 OF 1

FILENAME/PUTERREFERENCE
DWG #