REVISIONS	SYM	DESCRIPTION	DATE	APPROVED
	F	ADDED CAPACITOR C12	5-14-09	WLK BP

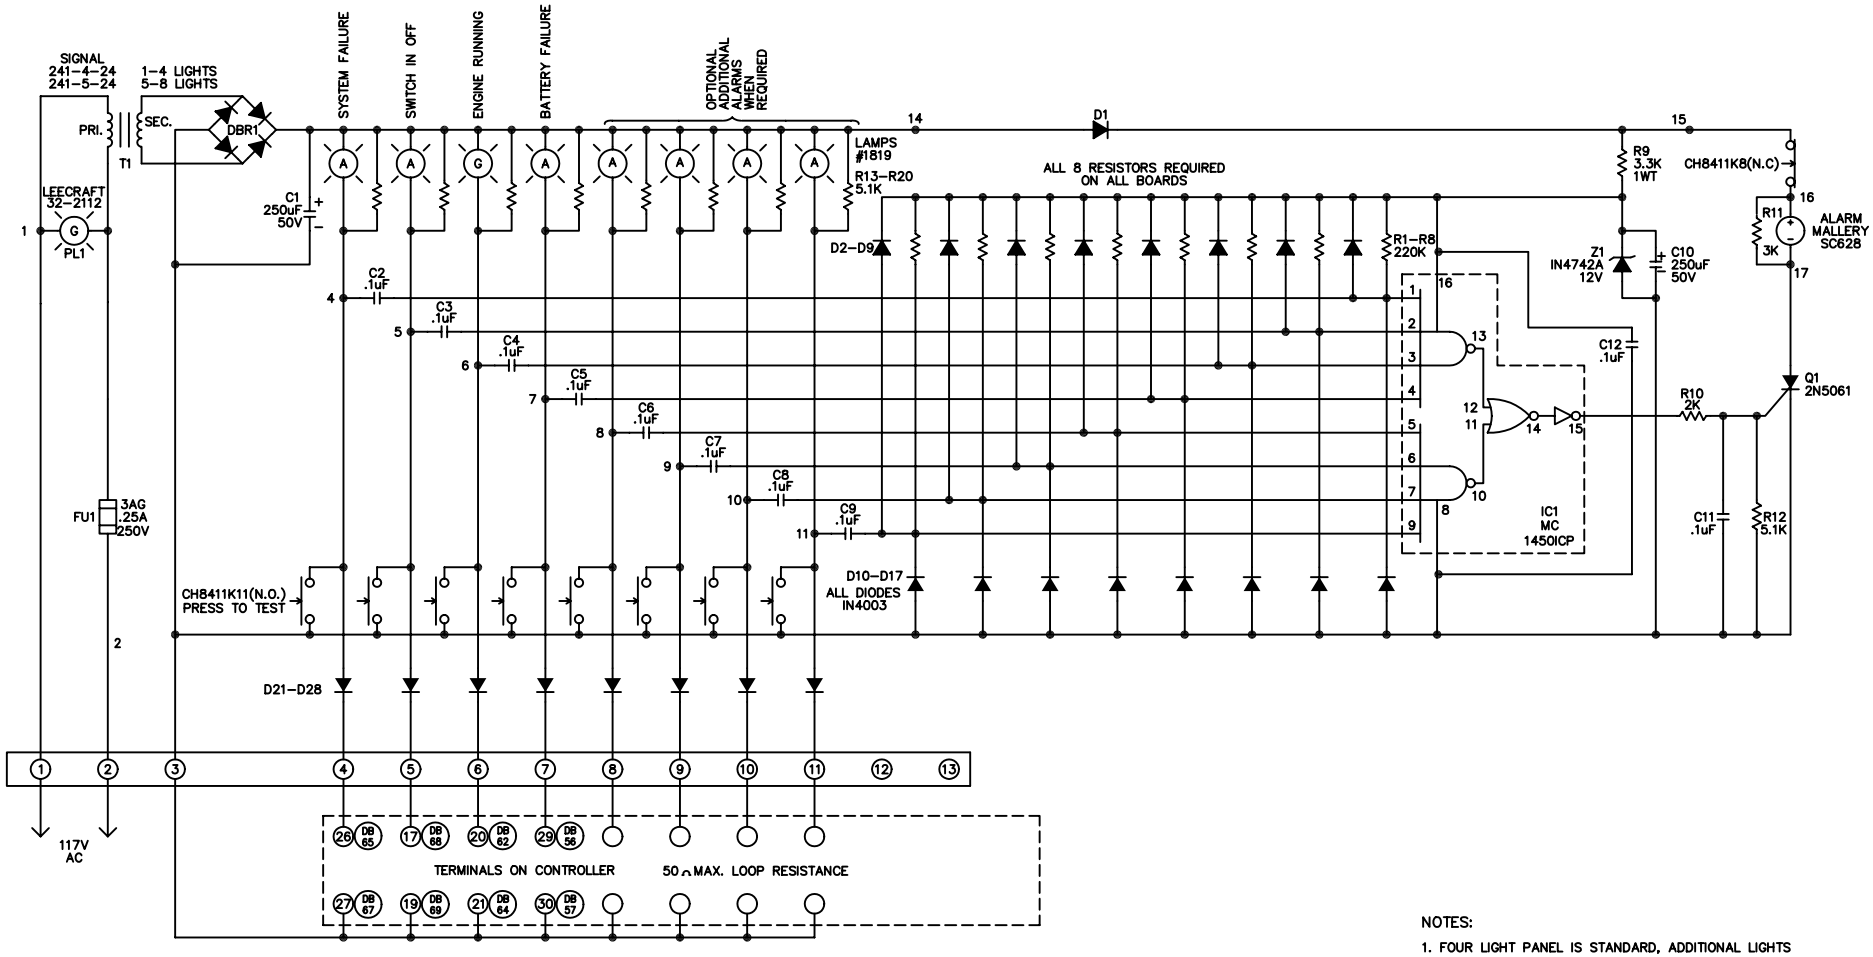

NOTES:

1. FOUR LIGHT PANEL IS STANDARD, ADDITIONAL LIGHTS AND FUNCTIONS MUST BE SPECIFIED.
2. ALL RESISTORS ARE 1/2 WT. UNLESS OTHERWISE NOTED.
3. IF TERMINALS 10 & 11 ARE NOT BEING USED FOR ADDITIONAL ALARMS, THEY WILL BE USED FOR THE CR1 CONTACT.
4. * DENOTES OPTIONAL COMPONENTS.
5. ○ DENOTES TERMINALS ON ANY METRON FD4 CONTROLLER
6. ⬡ DENOTES TERMINALS ON METRON FD2 CONTROLLER

DRAWN	SR	12-5-89
CHECK	WL	1-3-90
APPD	WL	1-3-90

METRON, INC.
DENVER, CO.

SCHEMATIC
MODEL 1802LB, REMOTE ALARM PANEL
CLOSE CIRCUIT TO ALARM

CS3178F

SCALE N.T.S. SHEET 1 OF 1