


REVISIONS	BY	DESCRIPTION	DATE	APPROVED
J	ADDED CAPACITOR C12		5-14-09	M.K. B/P

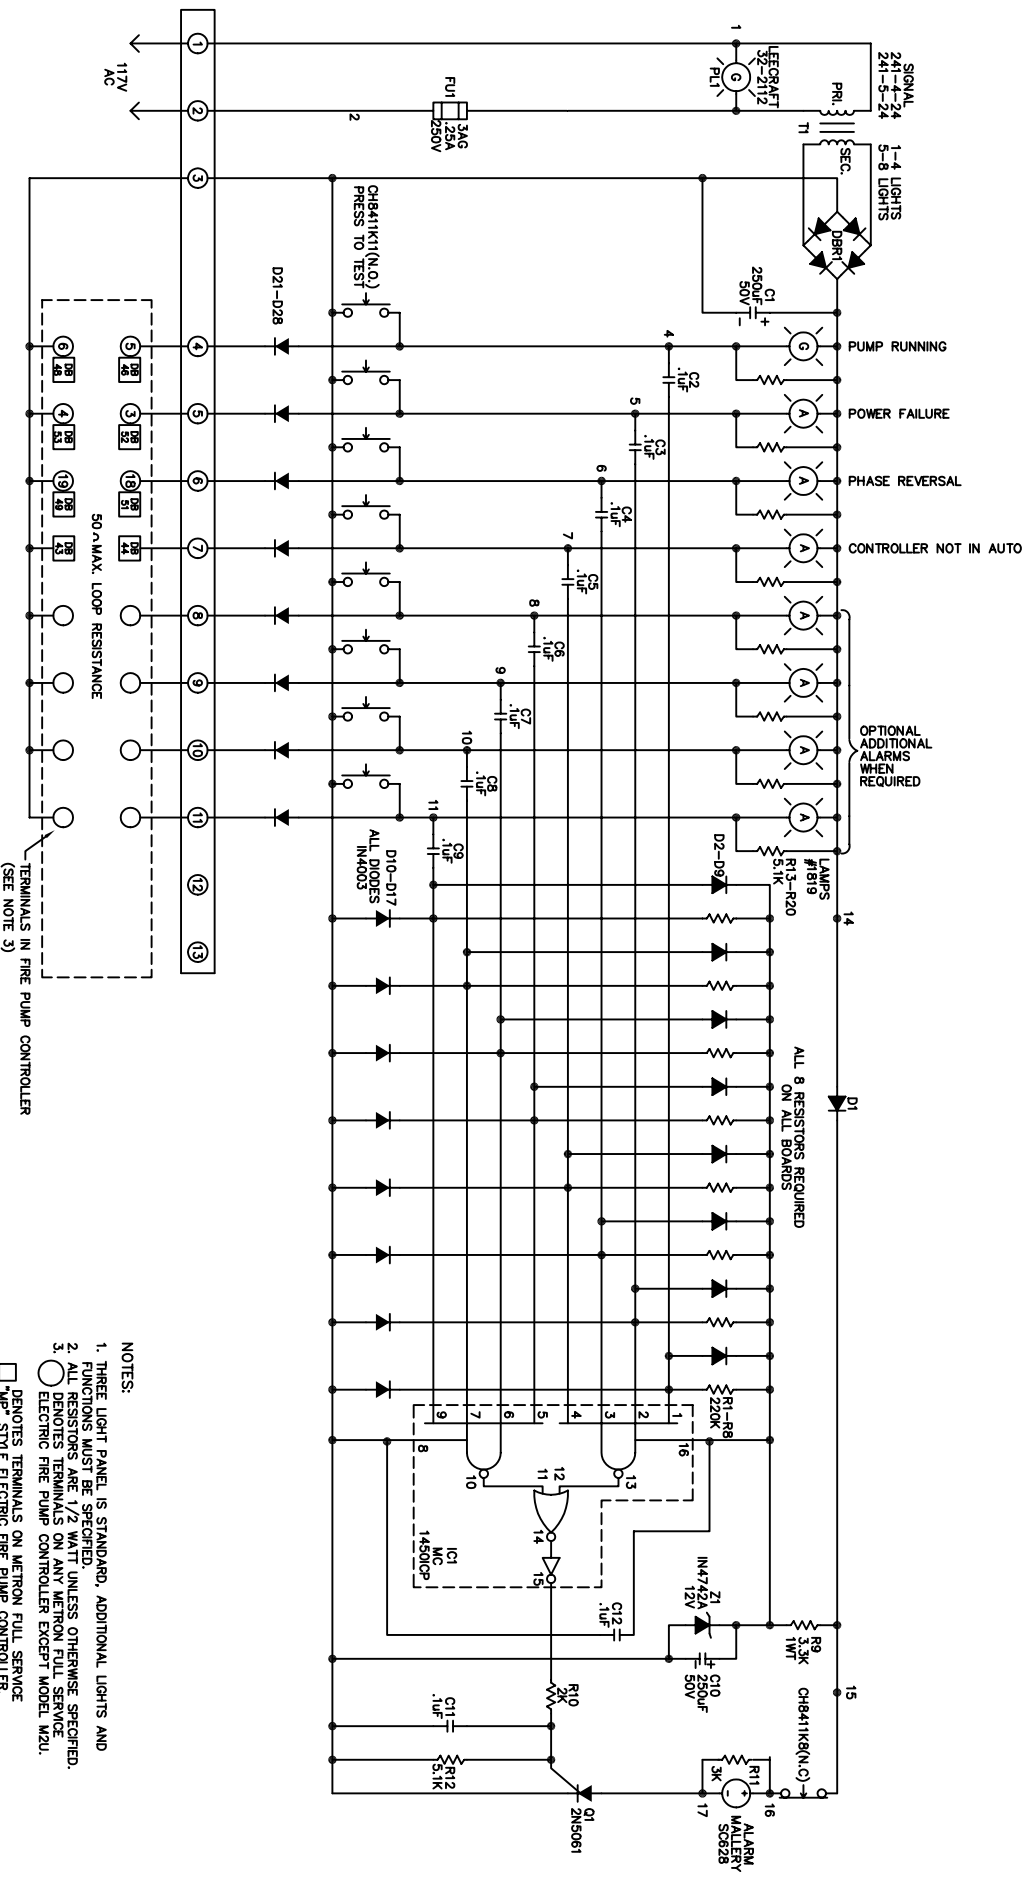

- NOTES:
- THREE LIGHT PANEL IS STANDARD. ADDITIONAL LIGHTS AND FUNCTIONS MUST BE SPECIFIED.
 - ALL RESISTORS ARE 1/2 WATT UNLESS OTHERWISE SPECIFIED.
 - DENOTES TERMINALS ON ANY METRON FULL SERVICE ELECTRIC FIRE PUMP CONTROLLER EXCEPT MODEL M2U. □ DENOTES TERMINALS ON METRON FULL SERVICE "MAP" STYLE ELECTRIC FIRE PUMP CONTROLLER.
 - IF TERMINALS 10 & 11 ARE NOT BEING USED FOR ADDITIONAL ALARMS, THEY WILL BE USED FOR THE CRT CONTACT.
 - * DENOTES OPTIONAL COMPONENTS.

SCHEMATIC		DRAWN		DATE	
MODEL 1701LB, REMOTE ALARM PANEL		M.K.		12-5-89	
CLOSE CIRCUIT TO ALARM		CHECK		1-3-90	
		APPD		1-3-90	
		M.K.			
		CS31789J		METRON, INC.	
		SCALE N.T.S.		DENVER, CO	
		SHEET 1 OF 1			